

EVHR AC / EVER AC

Ceiling Type Heat / Energy Recovery Unit with Heat Pump



EVHR AC/EC - EVER AC/EC Ceiling Type Heat / Energy Recovery Units with Heat Pump Aluminium Plate / Cellulosic Exchanger

Index

EVHR AC/EC - EVER AC/EC Ceiling Type Heat / Energy Recovery Units with Heat Pump Aluminium Plate / Cellulosic Exchanger

- Unit Components	2
- Performance Data - AC Fan Series	3
- Technical Specifications & Unit Dimensions - AC Fan Series	5
- Performance Data - EC Fan Series	6
- Technical Specifications & Unit Dimensions - EC Fan Series	8
- Unit Components & Working Principle of Unit	9
- Control System	10

Accessories

- Duct Type Electric Heaters	13
- Sound Attenuator For Circular Ducts	13

General Terms and Conditions of Sale	14
--------------------------------------	----

Evaporator & Condenser

Copper tube - aluminum fin type and high efficiency evaporator and condenser are used. At the entrance of the evaporator, refrigerant distributor is used for a uniform distribution. Since the pressure drops on the air side are reduced, the air speed of 2.7 m/sec or a lower value is selected for evaporator and condenser. There is a stainless steel drain pan under the evaporator and condenser.

Supply and Exhaust Air Fan (EVHR AC - EVER AC) - AC PLUG FAN

Backward curved plug fans are used in heat and energy recovery units. Fan blades have high aerodynamic efficient backward curved design. Plug fans are used for high efficiency and low sound levels. With AC Fans it is also possible to reduce maintenance costs as the fans are direct drive; free of belt and pulley.

Supply and Exhaust Air Fan (EVHR AC EC - EVER AC EC) - EC PLUG FAN

The fans in heat and energy recovery units are equipped with innovative Electronically Commutated EC motor technology. EC motors have higher efficiency and simple speed control than AC motors and can be connected directly to the AC mains. Fan blades have high aerodynamic efficient backward curved design. EC motors reduce the energy consumption and increase the energy efficiency of the unit. With EC Fans it is also possible to reduce maintenance costs as the fans are direct drive; free of belt and pulley.

Aluminum Cross-flow Exchanger (EVHR AC)

The aluminum plate heat recovery exchanger consists of flat aluminum plates sewed together on the edge. The sewing progress ensures leakage free design. As the edge dimension increases, the efficiency of the heat exchanger increases and pressure loss across the heat exchanger decreases. Increasing plate distance reduces both efficiency and the pressure drop. EVHR AC units are considering efficiency, pressure drop and cost effectiveness. In extreme climates, to protect the exchanger from freezing, fresh air electric heaters must be used.

Cellulosic Paper Type Crossflow Heat Exchanger (EVER AC)

EVER AC energy recovery ventilation units with heat pump have cellulosic crossflow, high efficient plate heat recovery exchangers. The exchanger transfers sensible heat and moisture between supply and exhaust air. Thus, it is also possible to transfer latent heat. With the optimization of heat exchanger, temperature and humidity efficiency is increased, pressure drop is decreased. Cellulosic paper type crossflow Heat Exchanger prevents decreasing moisture in winter time and increasing moisture in summer time.

Control System

ENECON control unit is developed for controlling of heat recovery units' equipments, meeting the demands coming from the customers and is user friendly designed. ENECON is capable of controlling the standard equipments and optional accessories. ENECON Control unit can perform the basic functions without any control panel; it is more functional used with Basic and Pro-Panel. Besides, the control unit can switch on/off via BMS, gets fault signal and controls all the functions via ModBus. Alternatives different from Enecon controller are listed in "Control System" part.

Casing & Insulation


High corrosion resistive 200 gr/m² galvanize coated steel is used for the casing. Inside of outdoor air side is 10 mm, outside of outdoor air side is 5 mm; inside of indoor air side is 10 mm insulated with non-flammable acoustics foam against sound and thermal conduction.

Filter

To increase indoor air quality and to protect the equipments used in unit, G class filters (according to EN 779 standard) are used for both exhaust and supply air streams.


Compressor and Heat Pump Cycle

High efficiency, fully hermetic compressors are used in the heat/energy recovery units with heat pump. Externally balanced thermostatic expansion valve is used in the unit. The system safety is ensured with low and high pressure pressurestats. The system can work in heating or cooling mode depending on the season selection on the control panel. The unit has an automatic free-cooling system which enables further savings in order to reduce operating costs.

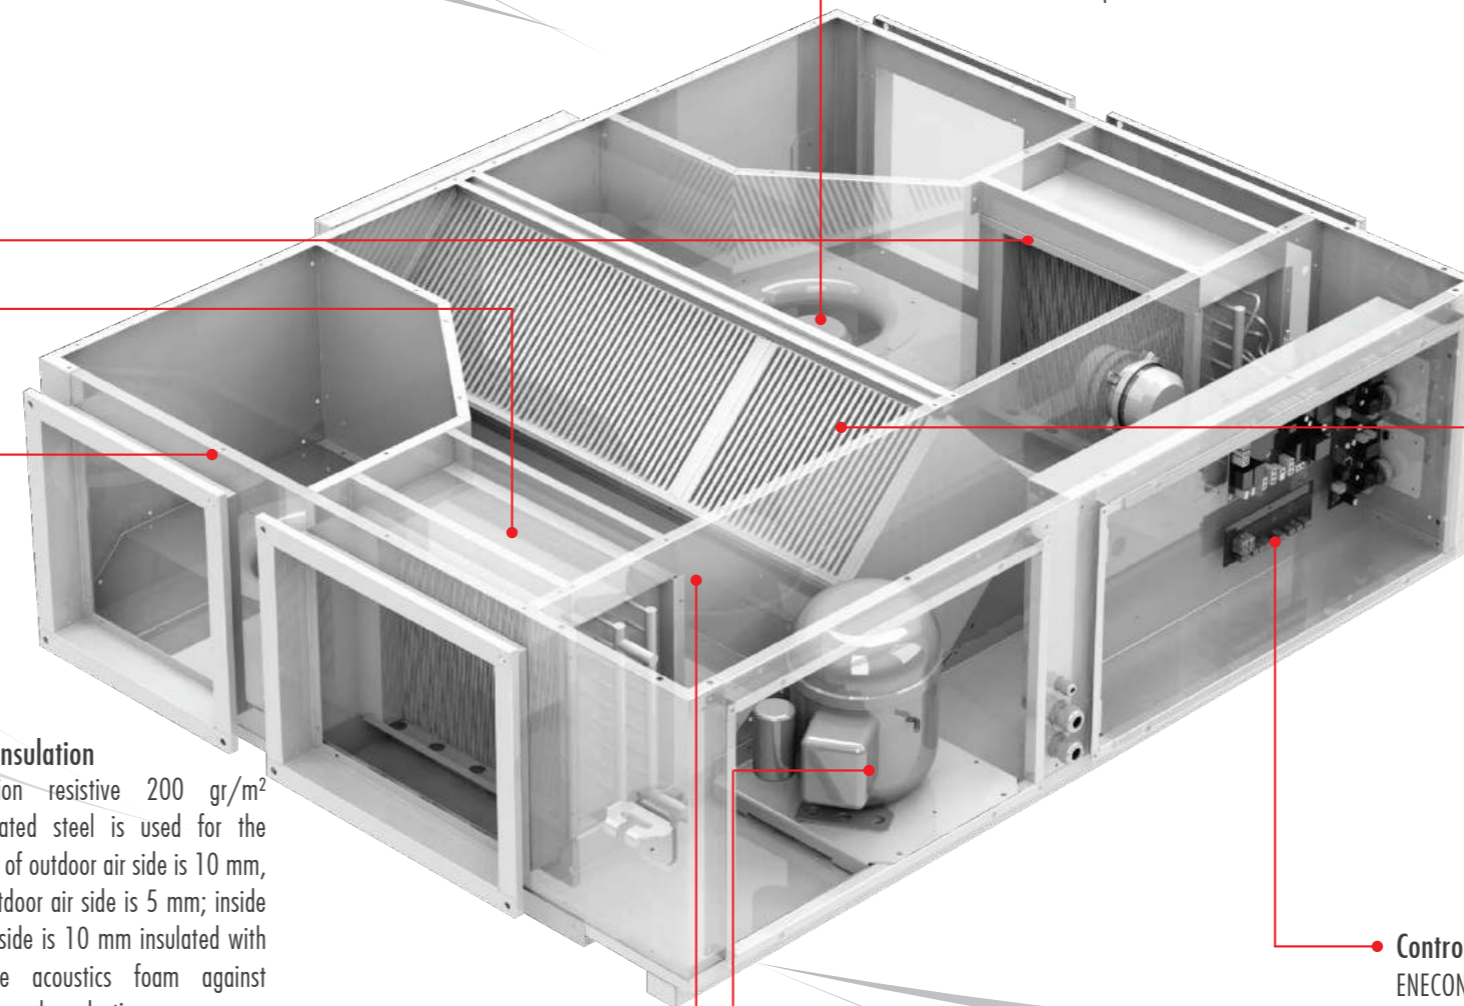


The technical specifications and the performance data declared with this logo have been developed by the tests performed in Eneko Energy Laboratory which is established with the development Project support of Tübitak by regarding relevant standards.


EVHR AC 500

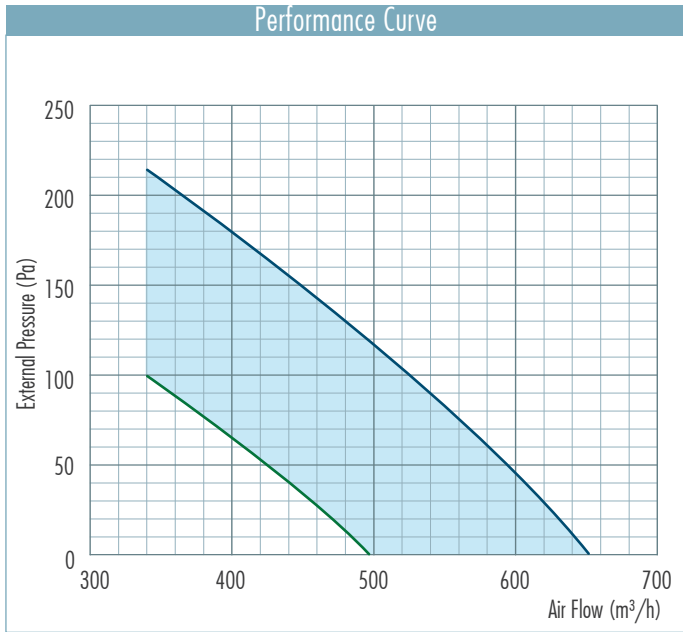


EVHR AC 750

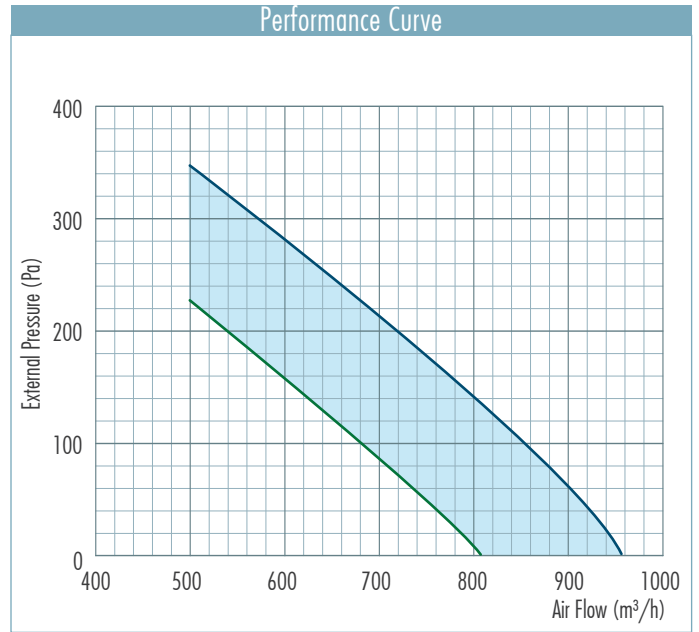

EVHR AC 1000

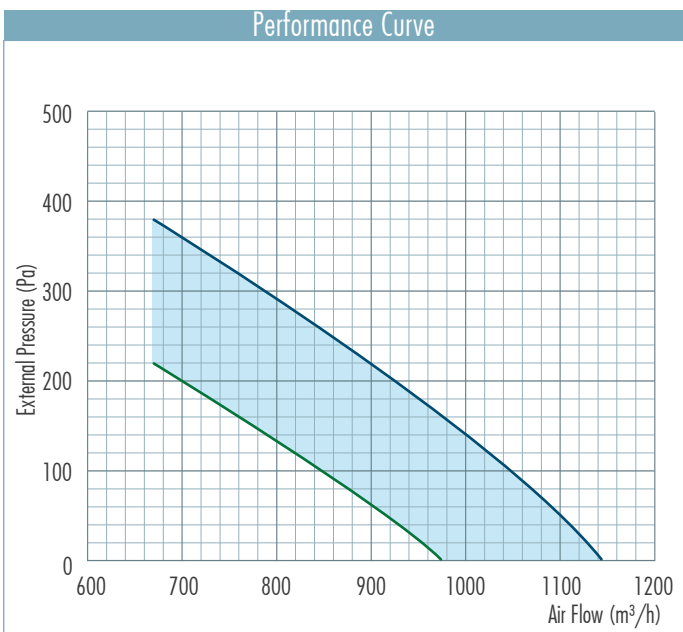


EVHR AC 1500

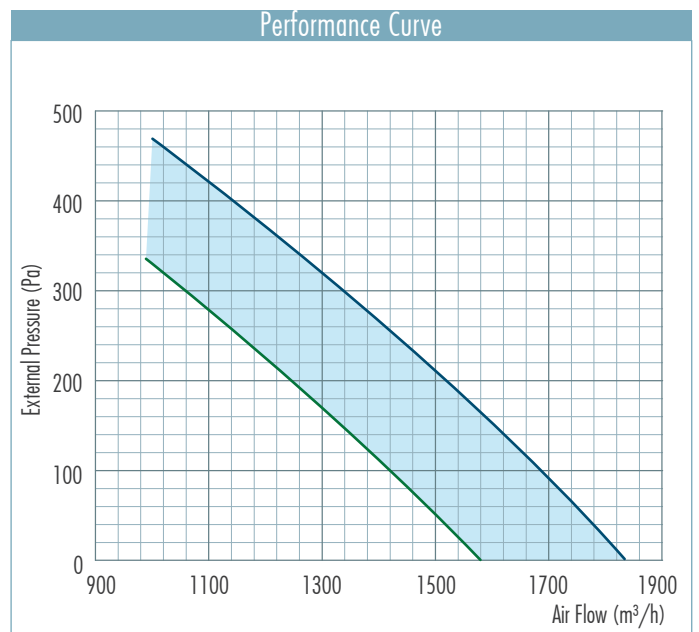


EVHR AC 2000

Performance Curve

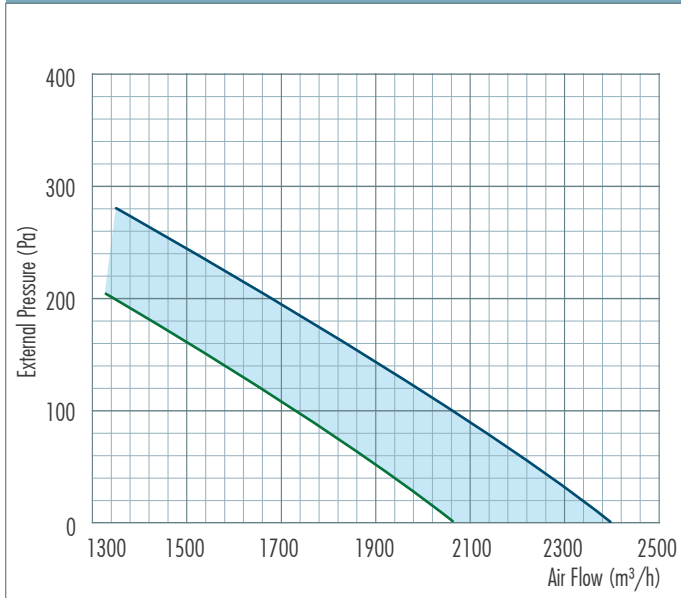


EVHR AC 3000

Performance Curve

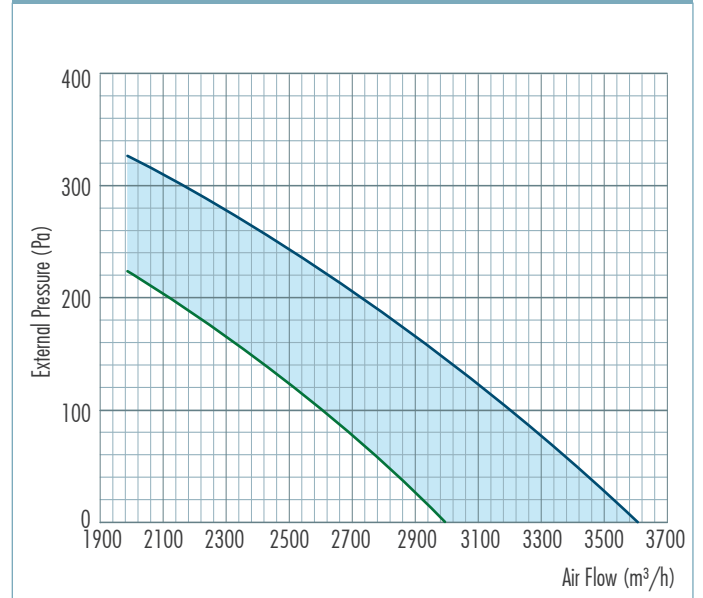

EVHR AC 4000

Performance Curve

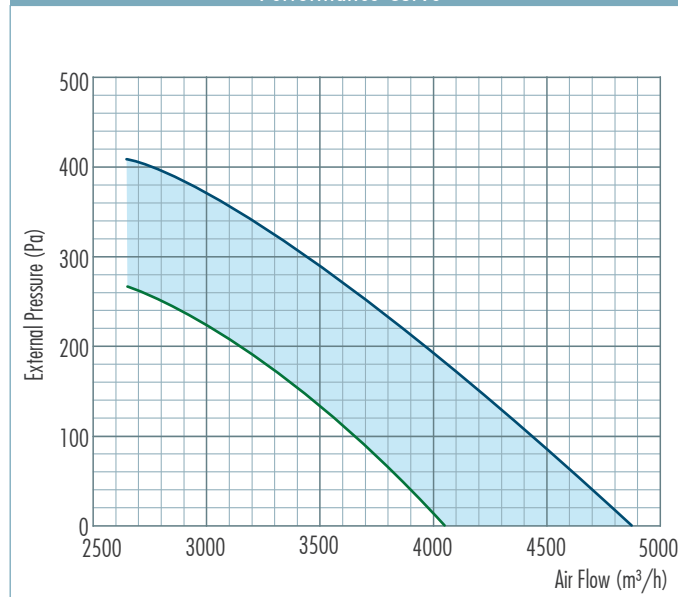

Technical Specifications & Unit Dimensions - AC Fan

		EVHR AC 500 EVER AC 500	EVHR AC 750 EVER AC 750	EVHR AC 1000 EVER AC 1000	EVHR AC 1500 EVER AC 1500	EVHR AC 2000 EVER AC 2000	EVHR AC 3000 EVER AC 3000	EVHR AC 4000 EVER AC 4000		
EVHR / EVER AC Technical Specifications	Air Flow	m ³ /h	500	750	1000	1500	2000	3000	4000	
	External Static Pressure	Pa	120	180	140	210	120	140	195	
	Max. Air Flow ¹	m ³ /h	650	960	1140	1830	2400	3600	4880	
	Nominal Voltage	V/Hz/Ph	230/ 50 / 1~					400/ 50 / 3~		
	Cooling	Capacity ²	kw	2.94	3.98	6	8.05	11.34	17.31	24.92
		COP	-	3.88	4.1	4.66	5.81	6.07	5.64	5.41
		Total Power ³	kw	1.18	1.62	2.01	2.74	3.24	5.22	8.40
	Heating	Capacity ²	kw	4.47	5.92	8.51	10.85	15.13	23.31	33.15
		COP	-	5.88	6.1	6.6	7.84	8.1	7.59	7.19
		Total Power ³	kw	0.96	1.39	1.72	2.41	2.81	4.49	7.21
Electric Heater Diameter	mm	Ø250	Ø250	Ø300	300x300	400x400	500x400	550x450		
Electric Heater (Optional) ⁴	kw	1.5	1.5	2	4	5	10	10		
Unit Weight	kg	105	110	150	200	280	410	360		
Filter Type		G Class								

Summer Condition: Outdoor air 35°C K.T. %40 rH & Indoor air 25°C K.T. %50 rH (evaporation 7,2 °C / condensation 50 °C)

Winter Condition: Outdoor air 0°C K.T. %80 rH & Indoor air 22°C K.T. %40 rH (evaporation -5 °C / condensation 40 °C)


¹ External static pressure is 0 Pa.

² Heat exchanger capacity is added to total heating and cooling capacities.

³ Total power is sum of compressor and fan power consumptions.


⁴ Electric heaters shall be used before the fresh air inlet of the unit to preheat air where outdoor air is below -5°C and condensation can occur. Also in humid climates return air ducts must also be insulated against condensation.

EVHR AC - EVER AC Unit Dimensions

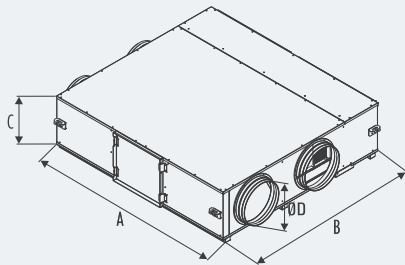

EVHR AC-EVER AC			
	500	750	1000
A	1250	1250	1400
B	1000	1000	1300
C	381	381	381
ØD	250	250	300

*All measurement values are mm.

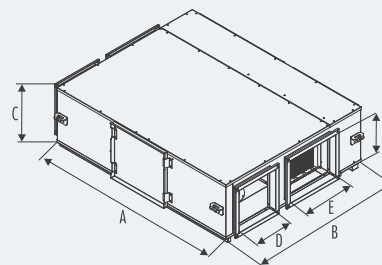


EVHR AC-EVER AC				
	1500	2000	3000	4000
A	1650	2100	2200	2200
B	1450	1620	1911	1911
C	440	587	587	650
DxF	300x300	400x400	500x400	550x450
ExF	600x300	550x400	800x400	800x450

*All measurement values are mm.

DxF: Outdoor air and indoor air connection
ExF: Supply air and exhaust air connection



Service Space & Installation

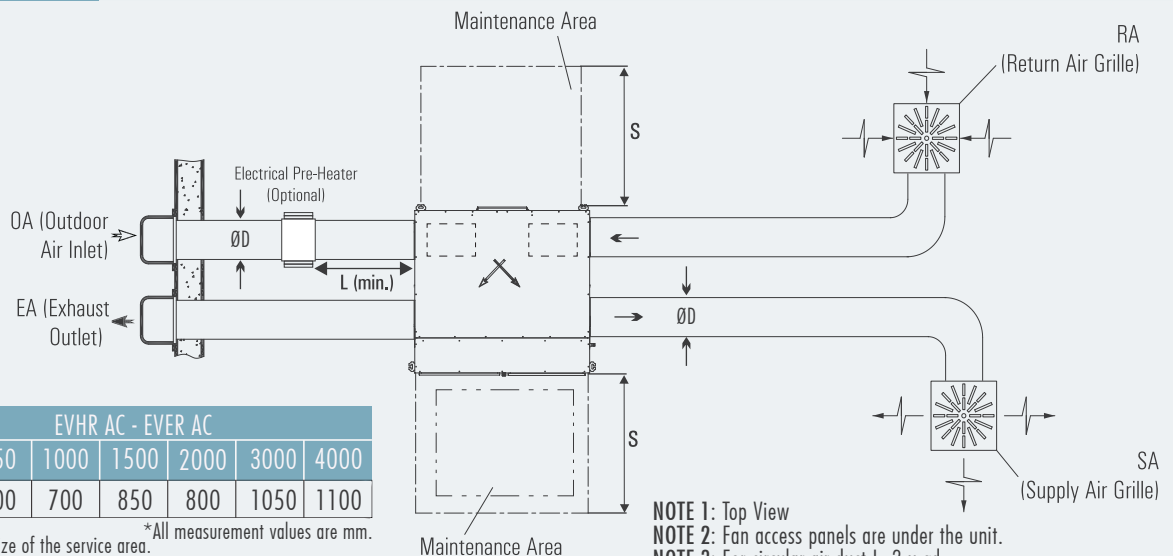


EVHR AC - EVER AC							
	500	750	1000	1500	2000	3000	4000
S	600	600	700	850	800	1050	1100


*"S" values indicate the size of the service area.
Drain pipe must be installed.
A service space of "C" must be left under the unit for fan service.

NOTE 1: Top View
NOTE 2: Fan access panels are under the unit.
NOTE 3: For circular air duct L=2 x ød
For rectangular air duct L=Duct diagonal length


EVHR AC 500 EC

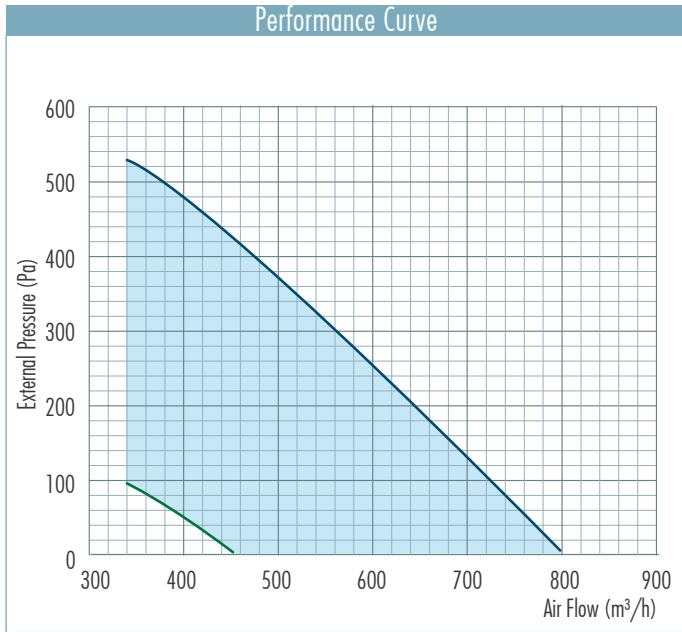


EVHR AC 750 EC

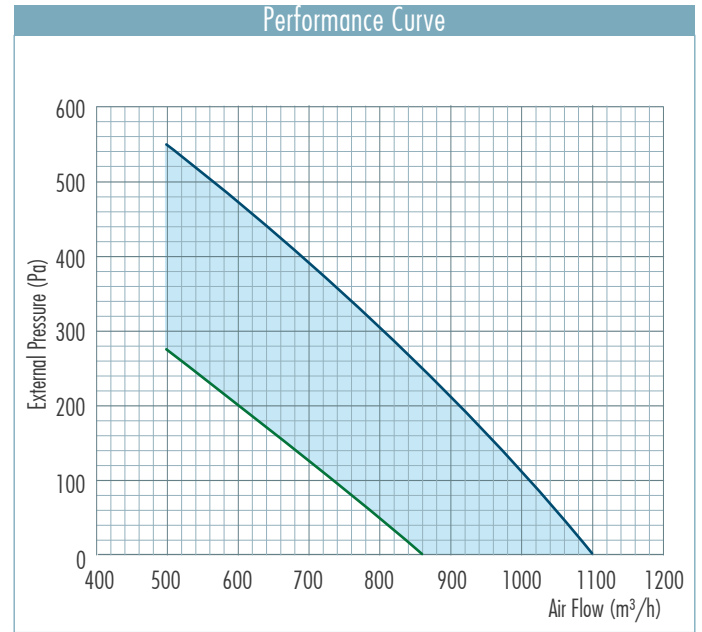


EVHR AC 1000 EC

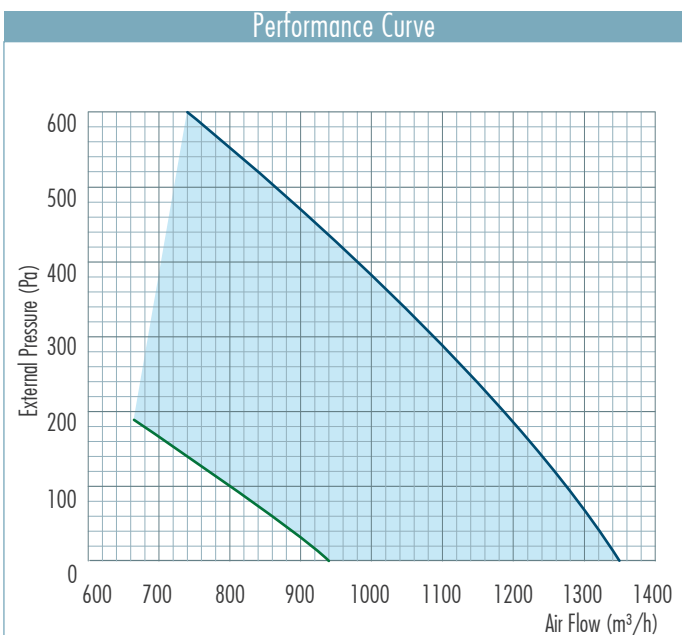


EVHR AC 1500 EC

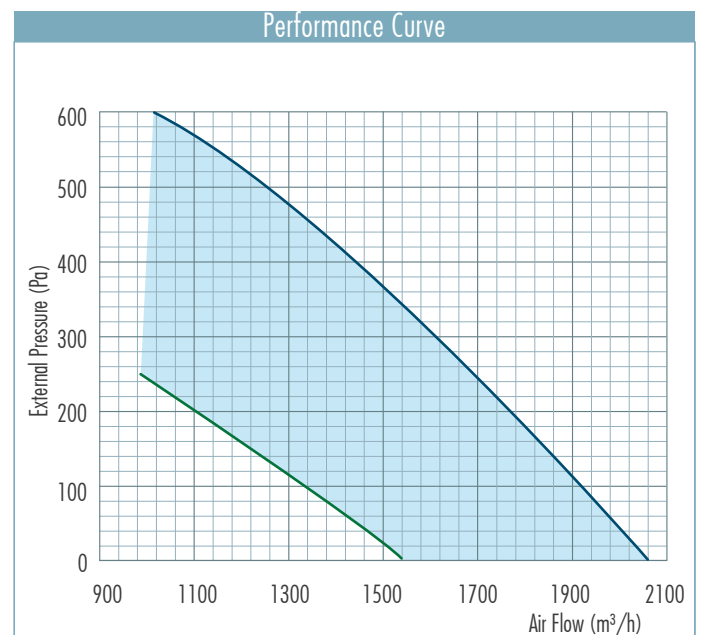


EVHR AC 2000 EC

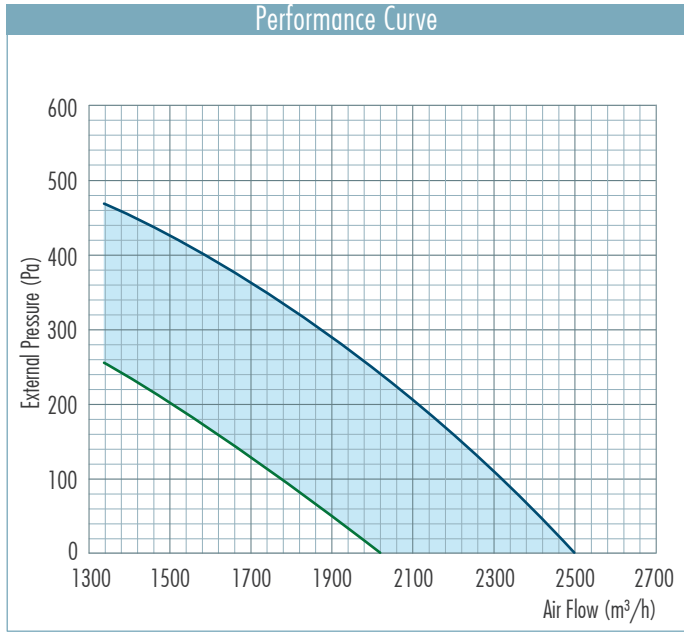

EVHR AC 3000 EC

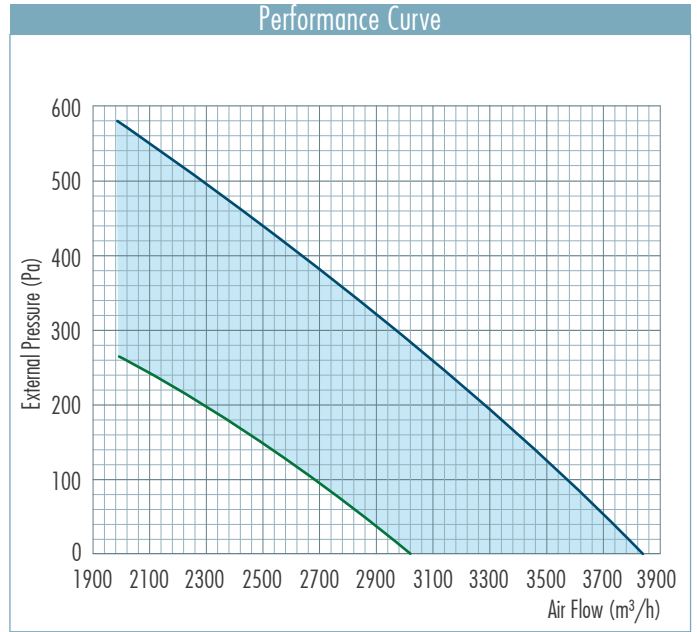

EVHR AC 4000 EC

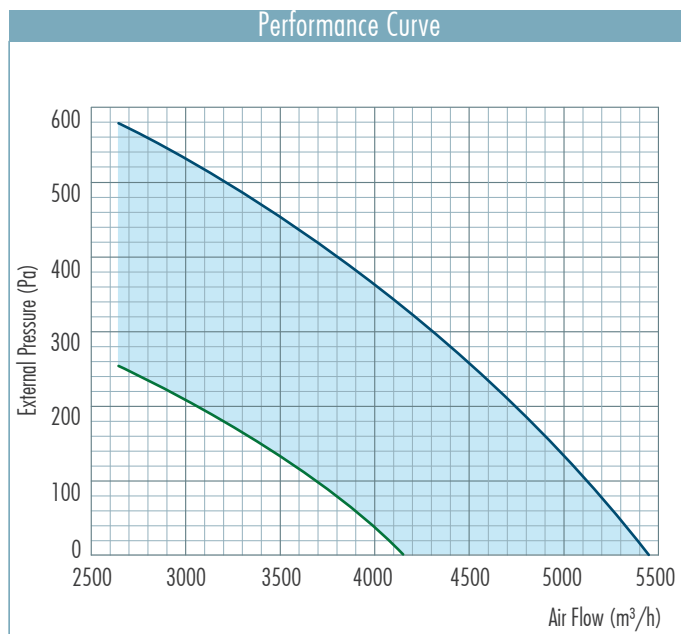

Technical Specifications & Unit Dimensions - EC Fan

		EVHR AC 500 EC EVER AC 500 EC	EVHR AC 750 EC EVER AC 750 EC	EVHR AC 1000 EC EVER AC 1000 EC	EVHR AC 1500 EC EVER AC 1500 EC	EVHR AC 2000 EC EVER AC 2000 EC	EVHR AC 3000 EC EVER AC 3000 EC	EVHR AC 4000 EC EVER AC 4000 EC		
EVHR / EVER AC EC Technical Specifications	Air Flow	m ³ /h	500	750	1000	1500	2000	3000	4000	
	External Static Pressure	Pa	375	350	380	365	250	290	360	
	Max. Air Flow ¹	m ³ /h	800	1100	1350	2060	2500	3850	5450	
	Nominal Voltage	V/Hz/Ph	230/ 50 / 1~					400/ 50 / 3~		
	Cooling	Capacity ²	kw	2.94	3.98	6	8.05	11.34	17.31	24.92
		COP	-	3.88	4.1	4.66	5.81	6.07	5.64	5.41
		Total Power ³	kw	1.31	2.20	2.58	2.71	3.20	5.31	9.03
	Heating	Capacity ²	kw	4.47	5.92	8.51	10.85	15.13	23.31	33.15
		COP	-	5.88	6.1	6.6	7.84	8.1	7.59	7.19
		Total Power ³	kw	1.10	1.97	2.29	2.38	2.77	4.58	7.84
Electric Heater Diameter	mm	Ø250	Ø250	Ø300	300x300	400x400	500x400	550x450		
Electric Heater (Optional) ⁴	kw	1.5	1.5	2	4	5	10	10		
Unit Weight	kg	105	115	150	200	280	410	360		
Filter Type		G Class								

Summer Condition: Outdoor air 35°C K.T. %40 rH & Indoor air 25°C K.T. %50 rH (evaporation 7,2 °C / condensation 50 °C)

Winter Condition: Outdoor air 0°C K.T. %80 rH & Indoor air 22°C K.T. %40 rH (evaporation -5 °C / condensation 40 °C)


¹External static pressure is 0 Pa.

²Heat exchanger capacity is added to total heating and cooling capacities.

³Total power is sum of compressor and fan power consumptions.


⁴Electric heaters shall be used before the fresh air inlet of the unit to preheat air where outdoor air is below -5°C and condensation can occur. Also in humid climates return air ducts must also be insulated against condensation.

EVHR / EVER AC EC Unit Dimensions

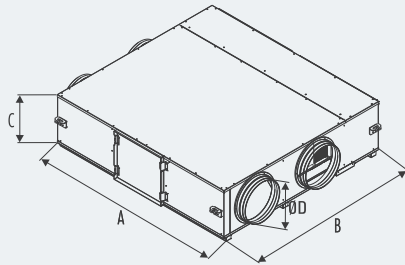

EVHR/EVER AC EC			
	500	750	1000
A	1250	1250	1400
B	1000	1000	1300
C	381	416	416
ØD	250	250	300

*All measurement values are mm.

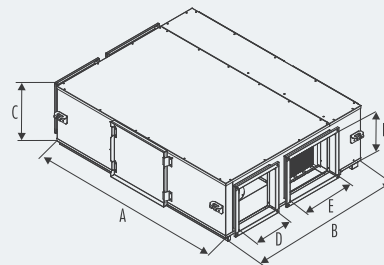


EVHR/EVER AC EC				
	1500	2000	3000	4000
A	1650	2100	2200	2200
B	1450	1620	1911	1911
C	475	622	622	685
DxF	300x300	400x400	500x400	550x450
ExF	600x300	550x400	800x400	800x450

*All measurement values are mm.

DxF: Outdoor air and indoor air connection
ExF: Supply air and exhaust air connection



Service Space & Installation

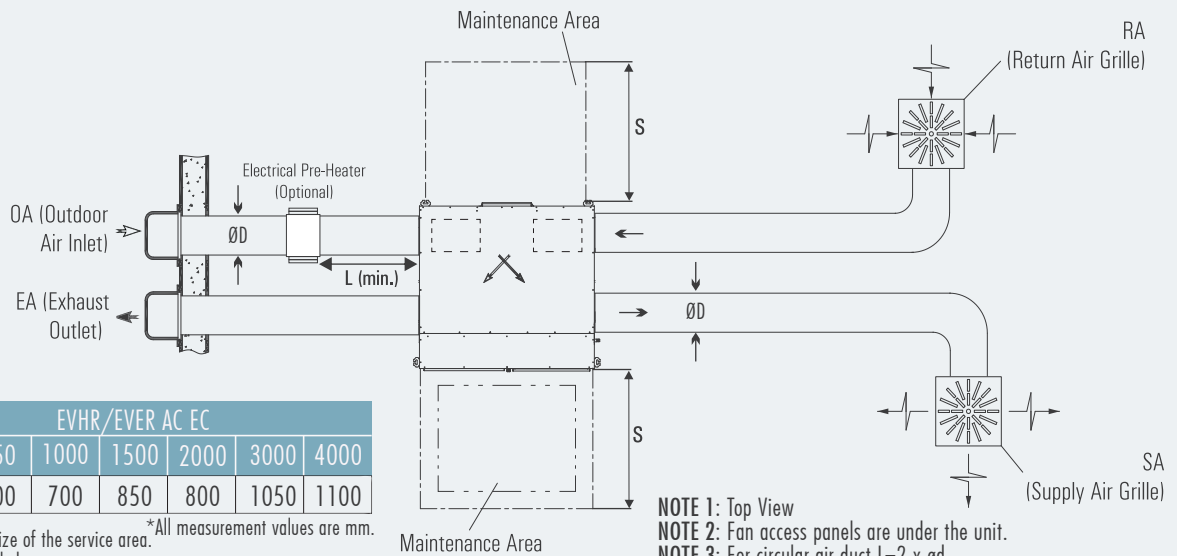

EVHR/EVER AC EC							
	500	750	1000	1500	2000	3000	4000
S	600	600	700	850	800	1050	1100

*"S" values indicate the size of the service area. *All measurement values are mm.

Drain pipe must be installed.

A service space of "C" must be left under the unit for fan service.

NOTE 1: Top View

NOTE 2: Fan access panels are under the unit.


NOTE 3: For circular air duct L=2 x ød

For rectangular air duct L=Duct diagonal length

■ Working Principle of the Unit



Outdoor air is cleaned from particles with G type filters and then it passes through the plate heat/energy recovery heat exchanger in EVHR AC/ EVER AC units. The supply air is preconditioned in the plate type heat/energy exchanger which is a type of heat exchanger that allows heat transfer between two air streams. Although the temperature and humidity of exhaust air is changed in the exchanger, it is still at appropriate temperature and humidity conditions and then it passes through the heat pump and is discarded to outdoor. Meanwhile outdoor air passes through the heat pump till the design temperature is achieved and then it is blown to inside.

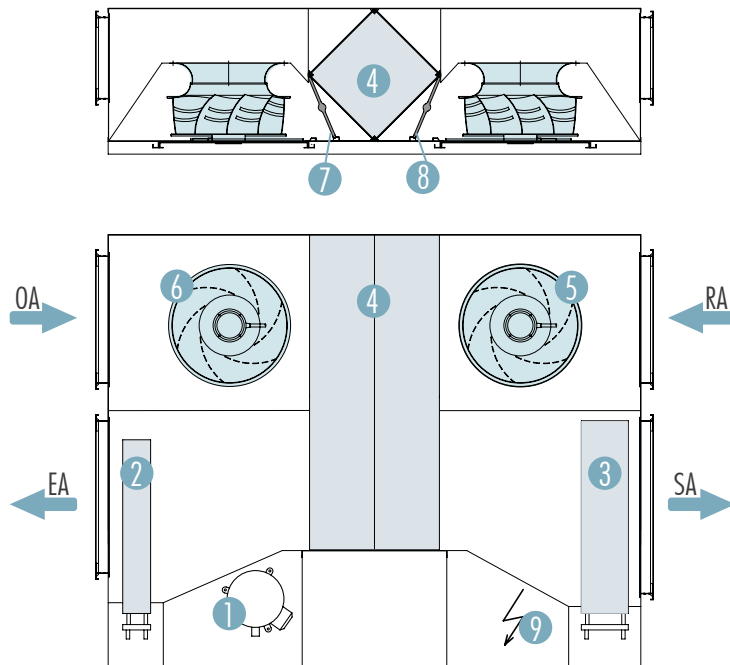

■ Unit Components

- 1 Compressor
- 2 Condenser
- 3 Evaporator
- 4 Aluminum Cross-flow Exchanger (EVHR AC)/
Cellulosic Paper Type Cross-flow Heat Exchanger (EVER AC)
- 5 Exhaust Fan
- 6 Supply Air Fan
- 7 Supply Air Filter
- 8 Exhaust Filter
- 9 Control Panel

■ Compressor and Heat Pump Cycle

High efficiency, fully hermetic compressors are used in the heat/ energy recovery units with heat pump. Externally balanced thermostatic expansion valve is used in the unit. The system safety is ensured with low and high pressure pressurestats. The system can work in heating or cooling mode depending on the season selection on the control panel. The unit has an automatic free-cooling system which enables further savings in order to reduce operating costs.



■ Evaporator & Condenser




Copper tube- aluminum fin type and high efficiency evaporator and condenser are used. At the entrance of the evaporator, refrigerant distributor is used for a uniform distribution. Since the pressure drops on the air side are reduced, the air speed of 2.7 m/sec or a lower value is selected for evaporator and condenser. There is a stainless steel drain pan under the evaporator and condenser.



■ EVHR AC / EVER AC

Automation Options		Control Cards		
Standard	Optional	Standard - Pro	Alternative	
			Type 1	Type 2
OA Temperature Sensor		☑	☑	☑
RA Temperature Sensor		☑	☑	☑
SA Temperature Sensor		☑	☑	☑
SA Fan Control		☑	☑	☑
RA Fan Control		☑	☑	☑
Compressor Control		☑	☑	☑
4 Way Control		☑	☑	☑
Modbus RTU		☑	☑	☑
Weekly Timer		☑	☑	☑
Filter Contamination Info (DPS)		☑	☑	☑
	On/Off Damper Control	☑	☑	☑
	Proportional Damper Control	⊗	☑	☑
	Airflow Control			☑
	Humidity Control	⊖	⊖	☑
	CO2 Control			☑
	On/Off Heating Coil	⊗	☑	☑
	Proportional Heating Coil	⊗	☑	☑
	On/Off Cooling Coil	⊗	☑	☑
	Proportional Cooling Coil	⊗	☑	☑
	Electrical Pre-Heater	☑	☑	☑
	BacNET MSTP	⊗	☑	☑
	Web Browser (TCP/IP)	⊗	⊗	☑

⊖ Only one of them of defined functions is selectable for this control card.

Control Panel		Control Cards		
Panel Type	Panel Descriptions	Standard - Pro	Alternative	
			Type 1	Type 2
	Standard-Pro Wall-mounted type, Max:50 m communication ability	☑	⊗	⊗
	Alternative-1.1 Hand Panel 1: Wall-mounted type, IP 65 protection class for only front side of panel, Max:50 m communication ability Hand Panel 2: Magnet type, IP 65 protection class for whole panel, Max:50 m communication ability	⊗	☑	☑
	Alternative-1.2 Magnet type, IP 31 protection class, Max:700 m communication ability	⊗	☑	☑

■ Selection of Electrical Cable Cross-Section

Electrical Cable Selection of Heat/Energy Recovery Unit with Heat Pump - 230V 1 phase								
Unit Model	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC - EVER AC			1.5	2.5	4	6	10	16
500	1.18	10	20	34	53	80	-	-
750	1.62	10	-	25	39	58	97	-
1000	2.01	16	-	-	32	47	78	125
1500	2.74	16	-	-	-	35	57	92
2000	3.24	20	-	-	-	29	49	78

Note: The values given in the table is the length of the cable in meters (m). Cable property: 3 x (phase + neutral + earth).

Electrical Cable Selection of Heat/Energy Recovery Unit with Heat Pump - 400V 3 phase+neutral								
Unit Model	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC - EVER AC			1.5	2.5	4	6	10	16
3000	5.22	3 x 10	35	58	93	140	-	-
4000	8.4	3 x 16	-	37	58	87	145	-

Note: The values given in the table is the length of the cable in meters (m). Cable property: 5x (phase1+phase2+phase3+neutral+earth).

Electrical Cable Selection of Heat/Energy Recovery Unit with Heat Pump - 230V 1 phase								
Unit Model	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC EC - EVER AC EC			1.5	2.5	4	6	10	16
500	1.31	10	18	30	48	72	-	-
750	2.2	16	-	18	29	43	71	-
1000	2.58	16	-	-	25	37	61	97
1500	2.71	16	-	-	-	35	58	93
2000	3.2	20	-	-	-	30	49	78

Note: The values given in the table is the length of the cable in meters (m). Cable property: 3 x (phase + neutral + earth).

Electrical Cable Selection of Heat/Energy Recovery Unit with Heat Pump - 400V 3 phase+neutral								
Unit Model	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC EC - EVER AC EC			1.5	2.5	4	6	10	16
3000	5.31	3 x 10	35	57	92	137	-	-
4000	9.03	3 x 20	21	34	54	81	134	-

Note: The values given in the table is the length of the cable in meters (m). Cable property: 5x (phase1+phase2+phase3+neutral+earth).

■ Selection of Electrical Cable Cross-Section

Electrical Cable Selection of Electric Heater - 230V 1 phase									
Unit Model	Heater Diameter (mm)	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC/EC - EVER AC/EC				1.5	2.5	4	6	10	16
500	ø250	1.5	10	41	68	109	163	-	-
		3	20	-	34	55	82	136	-
750	ø250	1.5	10	41	68	109	163	-	-
1000	ø300	2	16	31	51	82	122	203	-

Note: The values given in the table is the length of the cable in meters (m). Cable property: 3 x (phase + neutral + earth).

Electrical Cable Selection of Electric Heater - 400V 3 phase									
Unit Model	Heater Diameter (mm)	Unit Power Input (kW)	Fuse (A)	Cable Cross-Section (mm ²)					
EVHR AC/EC - EVER AC/EC				1.5	2.5	4	6	10	16
750	ø250	4.5	3 x 10	81	135	-	-	-	-
1000	ø300	5	3 x 10	73	121	-	-	-	-
1500	300x300	4	3 x 10	91	152	-	-	-	-
		8	3 x 16	46	76	121	-	-	-
2000	400x400	5	3 x 10	73	121	194	-	-	-
		10	3 x 20	37	61	97	146	-	-
3000	500x400	10	3 x 20	37	61	97	146	-	-
		15	3 x 32	-	41	65	97	162	-
4000	550x450	10	3 x 20	37	61	97	146	-	-
		20	3 x 40	-	31	49	73	121	-

Note: The values given in the table is the length of the cable in meters (m). Cable property: 4 x (phase1 + phase2 + phase3 + earth).

■ Duct Type Electric Heaters



Electric heaters are optionally supplied in cold climates for supply air. Electric heaters are manufactured according to circular or rectangular duct systems. Standard types are produced of stainless steel heating elements and galvanized metal casing. Stainless steel casing is also available.

Electric heaters are equipped with two excessive temperature protection. When inside of the electric heater's temperature is 70°C, "automatic excessive temperature protection" enables and electric heater disables automatically.

The electrical heaters, designed as maximum 2 steps, step automatically according to temperature that is set on room control panel with control panel. Eneko electric heaters are connected in Delta connection in standard models.

Heating Capacity Calculation

$$Q = 0,33 \times V \times (T_2 - T_1)$$

Q : Heating Capacity (W)

V : Air Flow through electric heater (m³/h)

T₁ : Fresh air temperature before the heater (°C)



T₂ : Supply air temperature after the heater (°C)

■ Sound Attenuator For Circular Ducts



Sound attenuators are designed for standard duct dimensions. Various lengths are available according to attenuation demand. Sound attenuation capacities are given in the table. For better performance sound attenuators can be used in series. For the best result the sound attenuators shall be installed just after the unit.

Notation

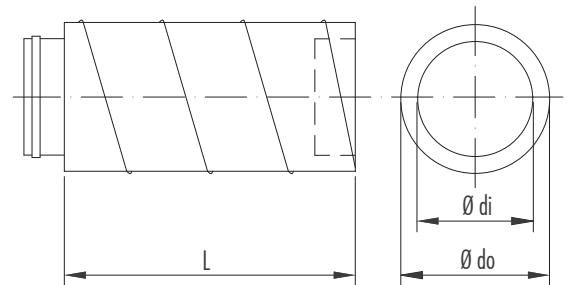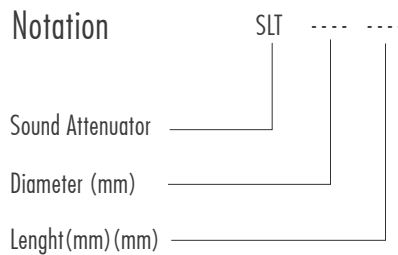

Sound Attenuator Capacity [dB]

SLT	63	125	250	500	1k	2k	4k	8k
200-300	1	2	3	6	10	14	12	14
200-600	2	3	6	7	13	17	18	20
200-900	3	4	7	10	16	18	21	22
250-300	1	2	6	6	13	16	14	15
250-600	2	3	7	7	18	21	20	22
250-900	3	4	9	8	21	24	21	23
300-300	1	2	4	4	10	12	12	15
300-600	1	3	6	7	13	15	17	19
300-900	2	4	7	8	15	17	18	21
355-600	1	3	8	8	9	6	5	7
355-900	4	4	13	13	11	7	6	8

Sound Attenuator Dimensions [mm]

SLT	long	Ø di	Ø do
200-300	300	200	260
200-600	600	200	260
200-900	900	200	260
250-300	300	250	310
250-600	600	250	310
250-900	900	250	310
300-300	300	300	360
300-600	600	300	360
300-900	900	300	360
355-600	600	355	415
355-900	900	355	415



GENERAL

The sale of all Products of ENEKO shall exclusively be made on the basis of these General Terms and Conditions of Sales. Any other conditions and General Conditions of Purchase of the Buyer are not accepted.



OFFERS

Our offers are non-binding and without obligation. Contracts for delivery and all other agreements (including subsidiary agreements) as well as declarations of our representatives shall only become legally binding for us after written confirmation. We do not render planning service.

Proposals made and information provided by our representatives shall be non-binding. Illustrations, drawings, dimensions and weights or other performance data shall only be binding if this is expressly agreed in writing.



TERMS OF ORDER

Purchase orders shall be sent to ENEKO in written form and shall be non-binding unless they are accepted by written confirmation (order confirmation) from ENEKO. Each order shall include properly identified Products ordered and relevant shipping dates.



PRICE OF THE GOODS

Prices are net Ex Works according to current Incoterms unless stated otherwise and do not include any kind of taxes. Prices are valid at the date of delivery will be applied. We reserve the right to adjust prices for confirmed orders as well to reflect any increase in our costs for any reason beyond our control like force majeure, shortage of primary material or labor strikes, official orders, transportation or similar problems. In this case, a new price agreement shall be required for higher rates. If such an agreement is not made, we shall be entitled to withdraw from the contract by written notice within 15 days.



TERMS OF PAYMENT

Payments shall be carried out according to the contractual terms as defined and set forth in the order confirmation. If the payment conditions have not been agreed upon conclusion of the contract, the payment terms and payment dates specified in our invoices shall be binding. Deadlines for discounts and periods allowed for payment shall begin to run upon receipt of the invoice. Payments by draft, bills of Exchange or anyway extended payments shall mean neither credit novation, nor prejudice to the Retention of Title agreement, nor to territorial competence. If buyer fails to make payment by due date, we are entitled to charge the buyer with a relevant interest on the unpaid amount.



TERMS OF DELIVERY

Delivery time information is only approximate. We shall only be in default if the performance is due and a written demand for payment was issued. Delivery day is the day of dispatch Ex Works. We shall also not be liable with regard to bindingly agreed periods and dates in the event of delays on a delivery and of performance due to force majeure and events which considerably complicate or make delivery impossible not only temporarily-strike lockout, breakdown, delay in supply with important raw and auxiliary materials even if the delay occurs at our supplier, in particular. These delays entitle us to postpone delivery for the period of the impediment plus a reasonable start-up period or to withdraw from the contract as a whole or in part. If delivery time is extended or we are released from our delivery commitment, the buyer may not derive a claim for damages from it. However, we may only rely on the circumstances mentioned if we notify the buyer immediately. We shall be entitled to make part deliveries. Any part delivery shall be considered as independent transaction. In case of default, our liability is limited to contract-typical foreseeable damage.



SHIPMENT

Shipment is made for the buyer's account. Mode of shipment and shipping route, transport and packaging and other securities respectively shall be at our choice. We shall be entitled, however, not obliged to insure deliveries in the name and for account of the buyer. Risk passes to the buyer when shipment is handed over to the person performing the transport or left our Works for shipment. If shipment is delayed upon buyer's request, risk passes to the buyer with the ready for shipment note. If ordered goods are rejected after the ready for shipment note, we shall be entitled to request payment and store the goods at buyer's expense. Discharge of the goods is made at buyer's expense.



RETENTION OF TITLE

In any event ENEKO shall retain full ownership of all materials supplied whilst the payment conditions of the entire amount have not been complied with, said materials may be removed from the customer at our request. Should the customer be declared bankrupt or insolvent and has not made paid the entire amount of payments. ENEKO shall be entitled to recover the goods. ENEKO may interrupt the supply without incurring any liability whatsoever if he had notice of or became aware of a decrease in the creditworthiness of the purchaser or if any of the existing negotiable instruments or debts were not properly complied with, shall result as being unpaid and protested.



WARRANTY

ENEKO Products are under warranty (defect in material or workmanship) for 2 years from the date of sale reflected on the invoice. Under this warranty, ENEKO is under the obligation to replace the part requested under warranty.

The followings are excluded from ENEKO warranty:

- Normal wear and tear
- Defective assembly or handling
- Third party compensation

Parts the subject of a claim shall be sent to our warehouse as carriage paid with relevant report completely filled in, wherein the parts shall be subjected to analysis.



LIABILITY

ENEKO, for any losses/damages, shall only be responsible within the limits of the law. Owing to basic obligations undertaken by simple negligence, if the contract is violated, ENEKO's liability shall be limited to compensate for losses which are emerged specific and predictable. ENEKO shall not carry any responsibility in case of a single negligence in breach of non-essential contractual obligations.



PROPERTY RIGHTS

The purchaser in no event and under no circumstances whatsoever shall publish or use the trademark, trade name or logo of ENEKO without a prior written permission.



GOVERNING LAW AND JURISDICTION

This agreement shall be governed with all aspects of the Turkish Law. The courts of Izmir/Turkey shall have an exclusive jurisdiction to adjudicate any dispute arising under or in connection with this agreement.

